



MODE

Source meter Ampere meter

Start sampling

Enable power output ☒

CAPTURE STATUS

Buffer 0% full

VOLTAGE ADJUSTMENT

DISPLAY OPTIONS

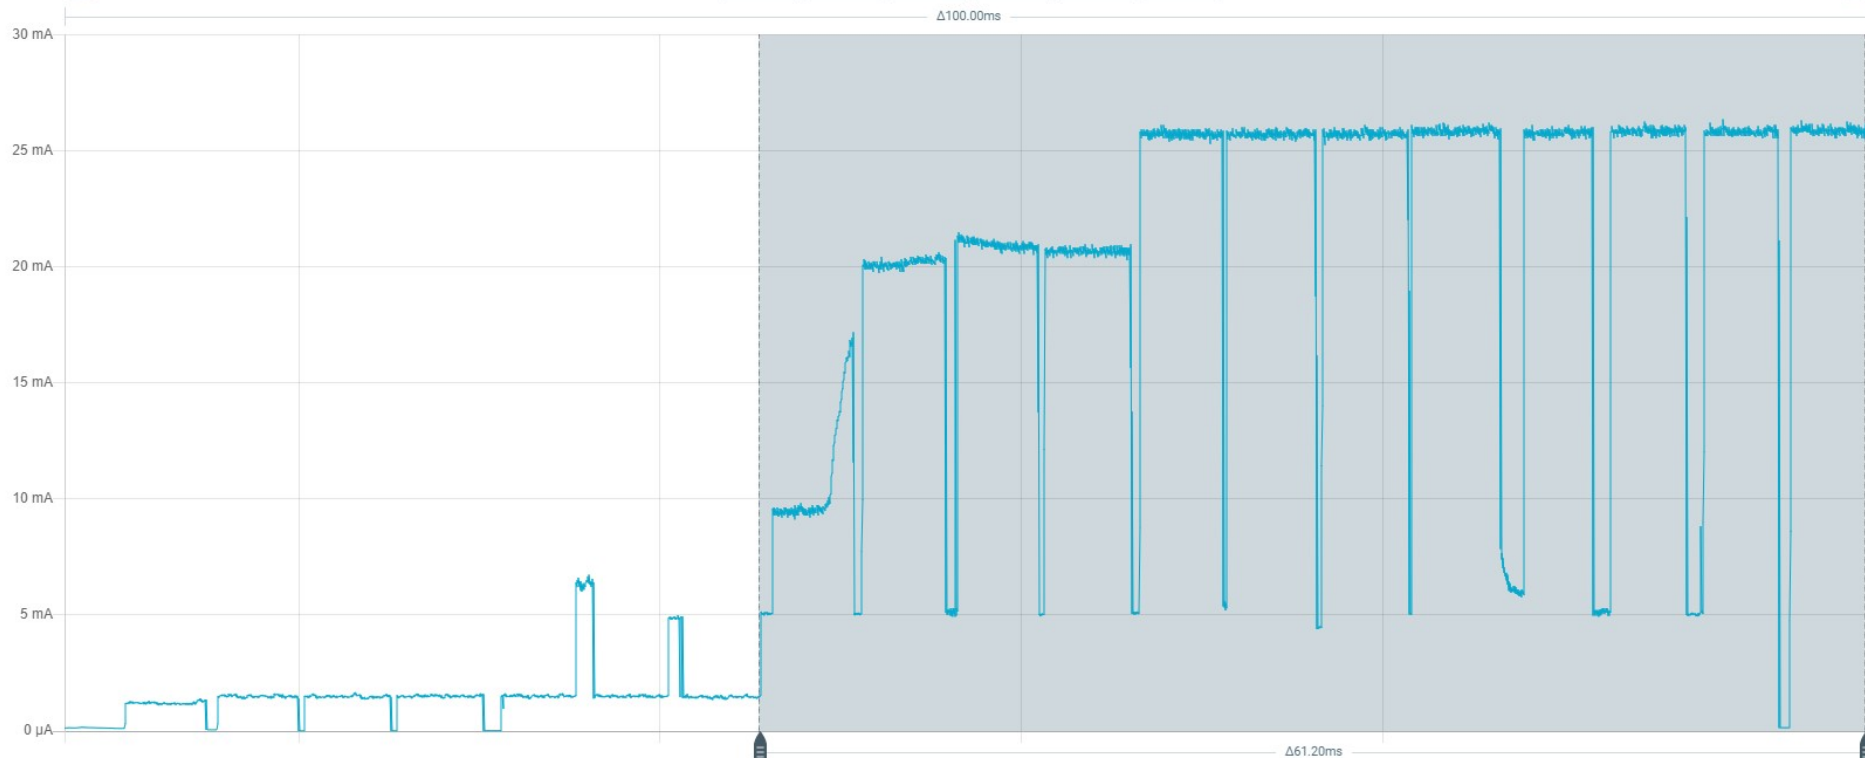
Timestamps ☒Digital channels ☒

0 1 2 3 4 5 6 7

Export

☒ LOCK Y-AXIS

10ms 100ms 1s 3s 10s 1min

LIVE VIEW ☒

WINDOW

13.53mA
average26.34mA
max100.00ms
time1.35mC
charge

SELECTION

21.07mA
average26.34mA
max61.20ms
time1.29mC
charge

CLEAR

22:44:10.708 Sampling started
22:44:17.326 Sampling stopped
22:44:22.961 Sampling started
22:44:26.780 Sampling stopped
22:44:28.387 Sampling started
22:44:29.115 Sampling stopped
22:44:29.347 Sampling started
22:44:33.816 Sampling stopped

☐ SHOW SIDE PANEL

CLEAR LOG

OPEN LOG FILE

☒ AUTOSCROLL LOG☒ SHOW LOG