



MODE

Source meter ● Ampere meter

Start sampling

Enable power output ☒

CAPTURE STATUS

Buffer 0% full

VOLTAGE ADJUSTMENT v

DISPLAY OPTIONS ^

Timestamps ☒

Digital channels ☒


0 1 2 3 4 5 6 7

Export

☒ LOCK Y-AXIS

10ms 100ms 1s 3s 10s 1min

LIVE VIEW ☒

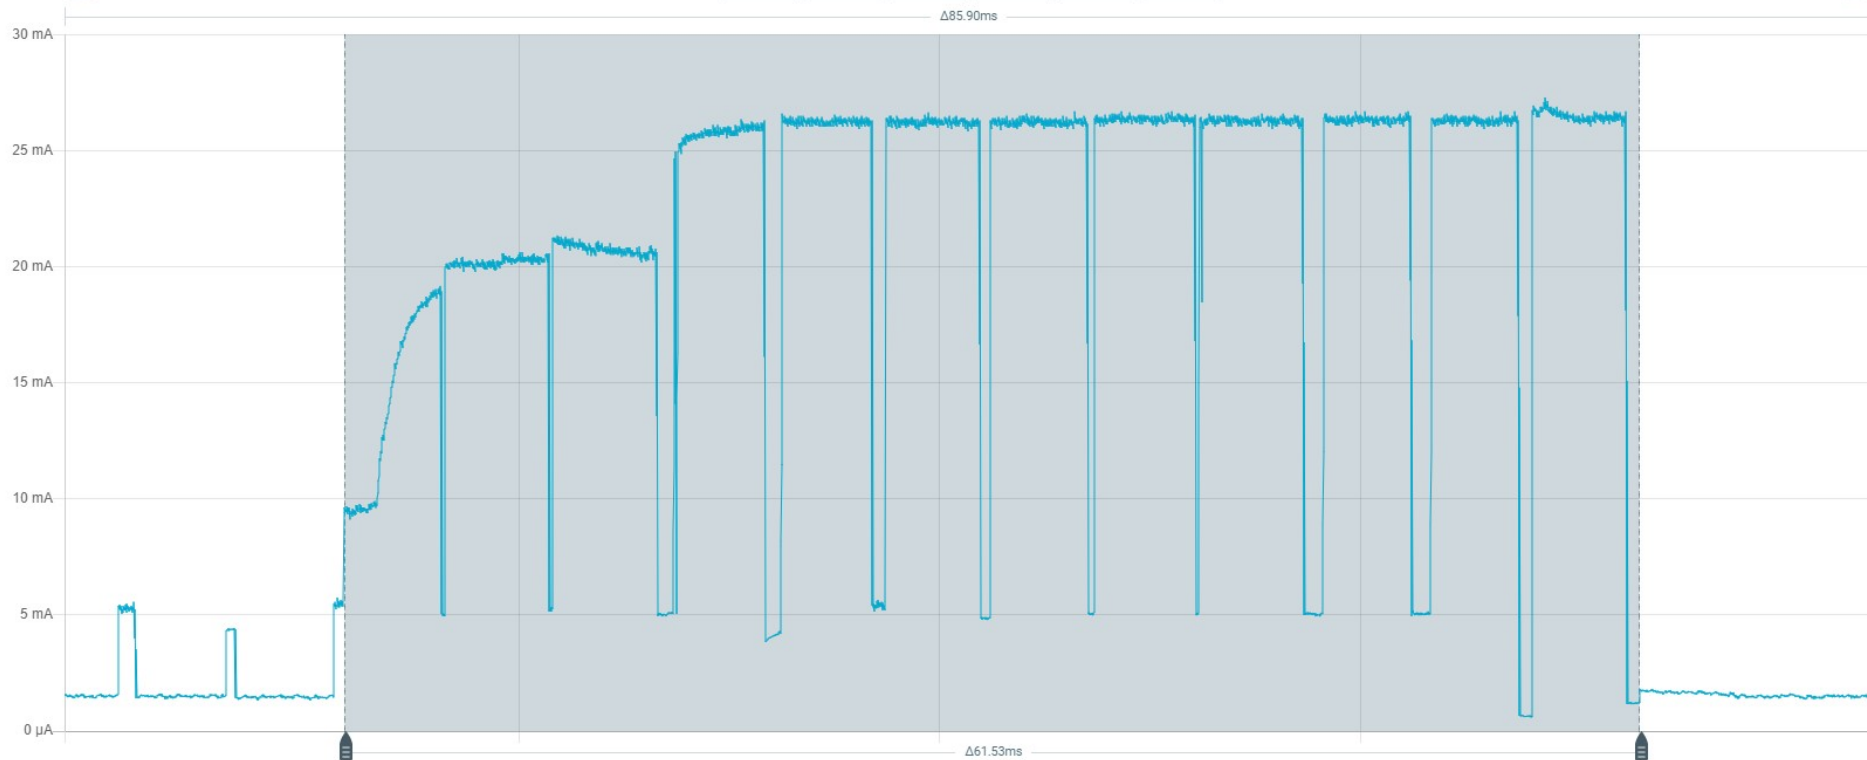

WINDOW

16.26mA average	27.28mA max	85.90ms time	1.40mC charge
--------------------	----------------	-----------------	------------------

SELECTION

21.99mA average	27.28mA max	61.53ms time	1.35mC charge
--------------------	----------------	-----------------	------------------

CLEAR

22:26:37.952 Opening device with s/n DC3DE9412DB1  
22:26:38.524 PPK started  
22:26:38.552 PPK opened  
22:26:48.155 Sampling started  
22:26:50.885 DUT ON  
22:28:04.918 Sampling stopped  
22:29:27.001 Sampling started  
22:30:26.513 Sampling stopped

☐ SHOW SIDE PANEL

CLEAR LOG

OPEN LOG FILE

☒ AUTOSCROLL LOG

☒ SHOW LOG