

MODE

Source meter Ampere meter

Start sampling

Enable power output

CAPTURE STATUS

Buffer 0% full

VOLTAGE ADJUSTMENT

DISPLAY OPTIONS

Timestamps

Digital channels


0 1 2 3 4 5 6 7

Export

LOCK Y-AXIS

10ms 100ms 1s 3s 10s 1min

LIVE VIEW

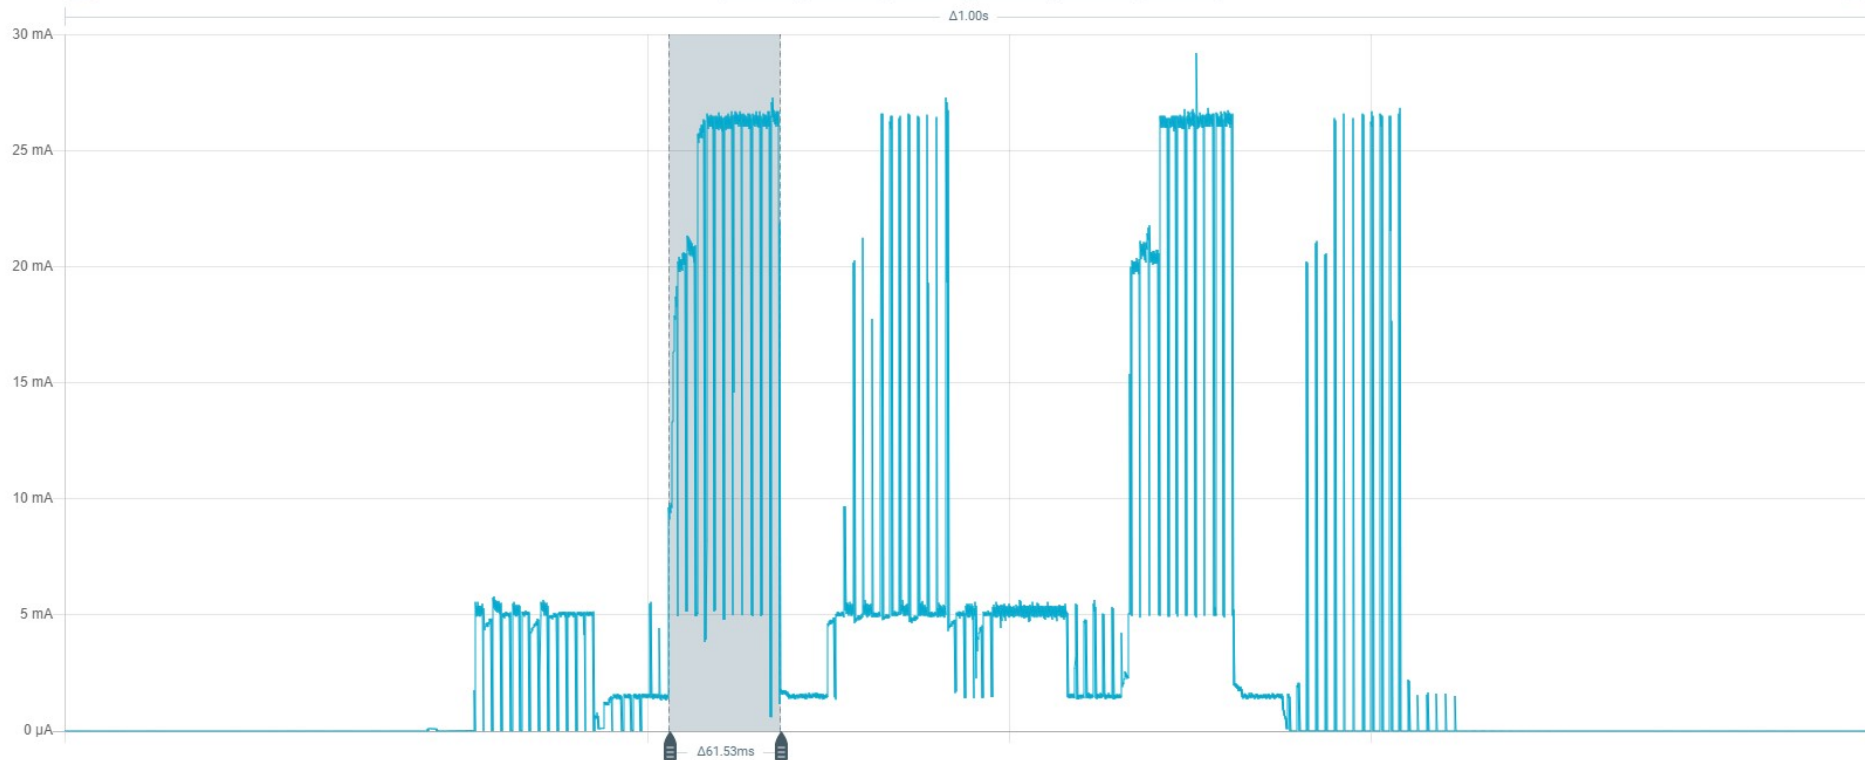

WINDOW

4.13mA average	29.19mA max	1.00s time	4.13mC charge
-------------------	----------------	---------------	------------------

SELECTION

21.99mA average	27.28mA max	61.53ms time	1.35mC charge
--------------------	----------------	-----------------	------------------

CLEAR

22:26:37.952 Opening device with s/n DC3DE9412DB1
22:26:38.524 PPK started
22:26:38.552 PPK opened
22:26:48.155 Sampling started
22:26:50.885 DUT ON
22:28:04.918 Sampling stopped
22:29:27.001 Sampling started
22:30:26.513 Sampling stopped

SHOW SIDE PANEL

CLEAR LOG

OPEN LOG FILE

AUTOSCROLL LOG

SHOW LOG