



MODE

Source meter Ampere meter

Start sampling

Enable power output

CAPTURE STATUS

Buffer 0% full

VOLTAGE ADJUSTMENT

Supply 3000 mV

DISPLAY OPTIONS

Timestamps

Digital channels


0 1 2 3 4 5 6 7

Export

LOCK Y-AXIS

10ms 100ms 1s 3s 10s 1min

LIVE VIEW

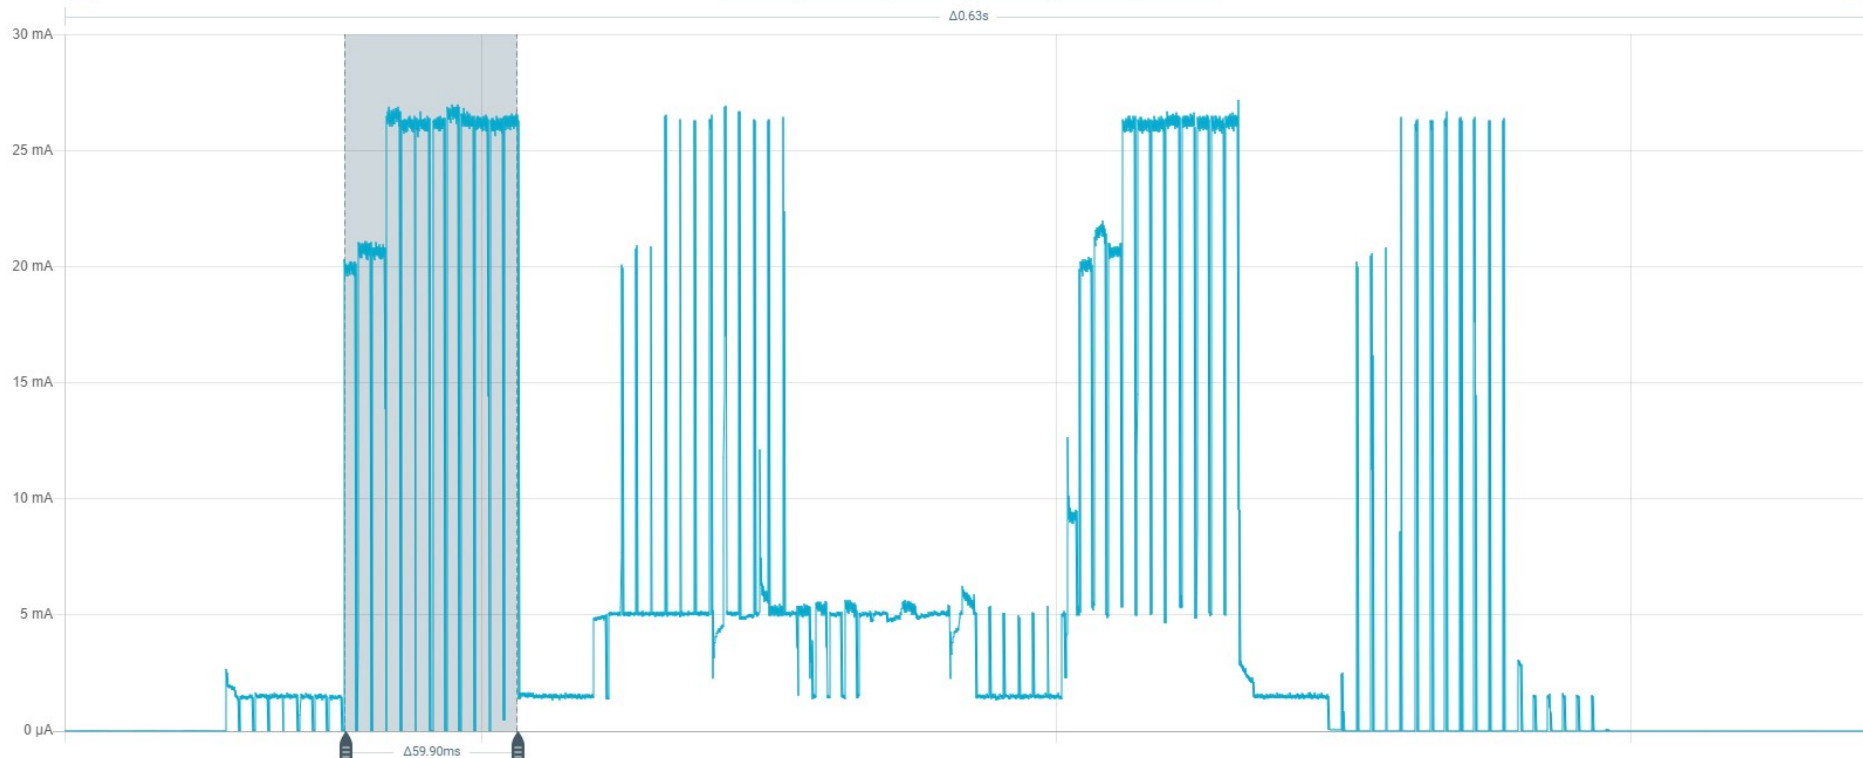

WINDOW

5.98mA average	27.18mA max	0.63s time	3.76mC charge
-------------------	----------------	---------------	------------------

SELECTION

22.48mA average	26.99mA max	59.90ms time	1.35mC charge
--------------------	----------------	-----------------	------------------

CLEAR

10:03:16.153 Sampling started
10:03:27.061 DUT OFF
10:03:29.478 DUT ON
10:05:02.672 Sampling stopped
10:05:03.488 Sampling started
10:05:20.747 Sampling stopped
10:10:49.557 Sampling started
10:17:14.543 Sampling stopped

CLEAR LOG

OPEN LOG FILE

AUTOSCROLL LOG

SHOW LOG

SHOW SIDE PANEL